


TEST LINK BOARD

Instrument Specification

A900

Test Link Board, indicates WTI CT current and allows safe current injection for WTI calibration

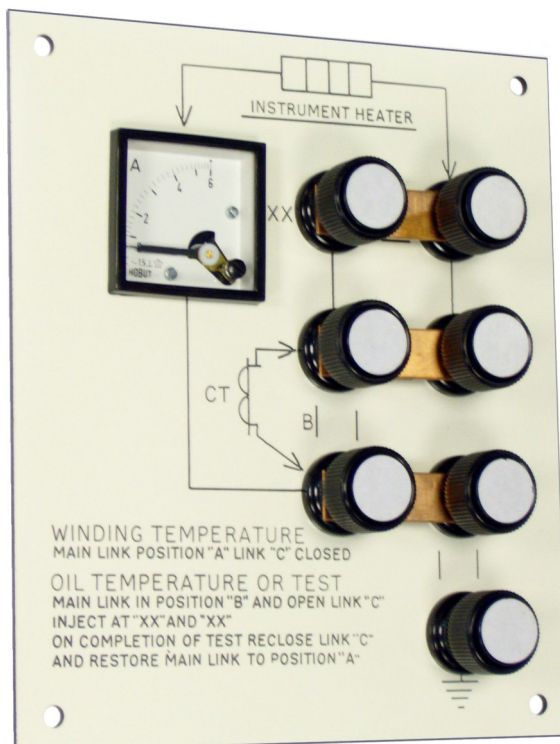

- Allows existing WTI to indicate Oil Temperature for CT calibration
- Provision for external injection of CT current for WTI calibration
- Class 1.5 Ammeter
- 0-6, 0-10 & 0-30 ammeters available
- Suitable for up to 20 amp C.T.
- 2000 volts isolation
- Can be supplied detailing transformer specific gradient and resistance values
- Optional Perspex cover provided



Issued: June 2016


Accurate Controls Ltd.

25 Cowley Road, Nuffield Industrial Estate,
Poole, Dorset, BH17 0UJ, United Kingdom.
Tel: +44 (0)1202 678108
Fax: +44 (0)1202 670161
e-mail: info@accurate-controls.ltd.uk
web: www.accurate-controls.ltd.uk



© ACL 2010

Dimensions

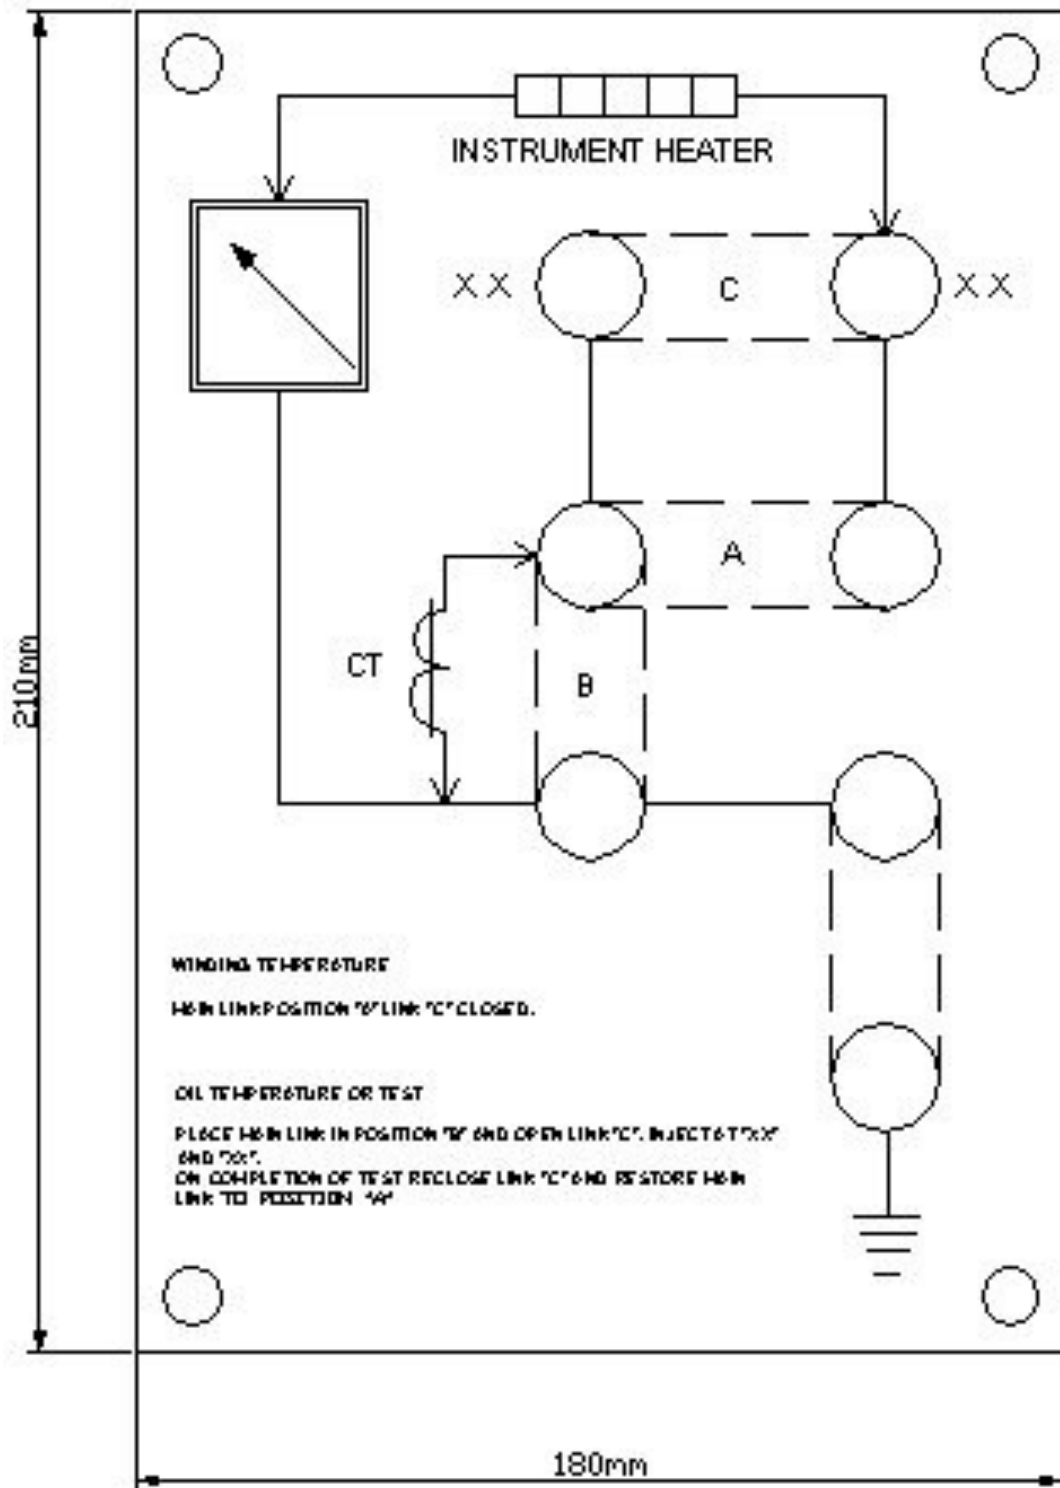

Please specify ammeter and gradient requirement at time of order

Full on site installation, calibration and maintenance service available.
 Please contact Accurate Controls for technical assistance.

SIDE VIEW

with dimensions

